

# Performance Analysis of Air Conditioner using R290 as Refrigerant with and Without Nanoparticles

Goutam Mishra, Assistant Professor, Department of Mechanical Engineering, Krupajal Engineering College, Bhubaneswar  
Sangram Behera, Assistant Professor, Department of Mechanical Engineering, NM Institute Of Engineering & Tech,  
Bhubaneswar

Yashobanta Sahoo, UG Student, Department of Mechanical Engineering, Krupajal Engineering College, Bhubaneswar  
Sidharth Nayak, UG Student, Department of Mechanical Engineering, Krupajal Engineering College, Bhubaneswar

**Abstract**—R22 is commonly used refrigerant in air conditioning systems. These HCFC refrigerants have negative impact on the environment which causes ozone depletion. Hence the usage of these HCFC refrigerants needs to be avoided. An alternative refrigerant need to be evaluated as an alternative to these HCFC refrigerants and R290 is suitable as alternative refrigerant due to its low ODP and low GWP.

In this, Cu doped MgO Nanoparticles are synthesized and the nanoparticles are used for the preparation of Nano-lubricant with different concentrations. An experimental investigation is performed on the air conditioner using R290 as refrigerant with and without Cu doped MgO nanoparticles in compressor lubricant oil. The system performance is analyzed and compared with and without using nanoparticles based on the performance parameters such as refrigeration effect, compressor work input and COP.

**Keywords**— R22; R290; GWP; ODP; Nanoparticles; refrigeration effect; compressor work input; COP.

## I. INTRODUCTION

To improve the coefficient of performance (COP) of the vapor compression refrigeration system (VCRS), different methods are adopted as reported in the literature. Bilir Nagihan and Kursad Ersoy (2009) have studied the role of a two-phase constant area of the ejector for improvement in the performance of a refrigeration system by recovering the kinetic energy at expansion process, and as a result reducing the compressor work. Sattar et al. (2007) has reported the performance improvement of a VCRS utilizing refrigerant R134a when various blends of hydrocarbons are used. With the advent of nanotechnology, in the literature survey, many have studied the effect of nanoparticles as additives, in refrigerant or in mineral oil used as the lubricant, on the COP of the VCRS. Park and Jung (2007) studied due to the addition of the carbon nanotubes the boiling heat transfer in refrigerants enhanced. Lee et al. (2009) has stated an improvement in the lubrication characteristics is found when the refrigeration mineral oil containing 0.1 vol. % of fullerene nanoparticles. Bi et al. (2008) studied that when 0.1% mass fraction of TiO<sub>2</sub> nanoparticles in R134a and Polyolester (POE) oil system are used in the VCRS has reduced the power consumption about 26%.

Stability of nanoparticles in suspension is one of the key issues which make the application of nanoparticles in refrigerants difficult, but it is also hard because the fluid

undergoes a phase change in every cycle. Lubricants enhance the performance of a system in several ways when additives are added to it. When the nanoparticles are added to lubricants, the critical parameters improved are anti-friction, anti-wear, anti-corrosion, extreme pressure, detergent and anti-oxidant. With increasing complications in operating conditions and development in technology coupled with increasing lubrication requirements are the necessary factors for the exploration of the new kind of additives and optimum value of their concentrations. Nanoparticles are regarded as the most important prospect to meet these demands. The performance of composites, oils, fluids, etc. are enhanced due to the addition of nanoparticles, which is due to high surface area to volume ratio that is leading to the extensive interaction between tribo contact points and lubricants containing nanoparticles.

## II. PREPERATION OF NANO-LUBRICANT

MgO is an important material that has wide range of applications in catalysis, toxic waste, remediation, paints, superconducting products and anti-bacterial activities. The MgO compound has boiling point about 3600°C and melting point as 2852°C. These oxide materials can be synthesized by different methods like solution combustion, chemical precipitation, sol-gel, hydrothermal, solvothermal, microwave assisted sol-gel, and green synthesis etc. Among these methods, co-precipitation method is one of the best methods to synthesis nanoparticles without agglomeration in the production.

Cu doped MgO nanoparticles will be prepared by Co-precipitation method. The samples were synthesized under laboratory conditions in clean room and analyzed using such as X-ray Diffraction (XRD) and Scanning Electron Microscopy (SEM).

### A. Synthesis and Analysis of Cu doped MgO Nanoparticles

- Prepare a solution mixture of 0.6M Magnesium Chloride and 0.01M Copper Chloride. Also prepare 0.1M KOH solution.
- Mix KOH solution drop wise to the mixture solution of Magnesium Chloride and Copper Chloride and kept under constant stirring for three hours then we obtain a green bluish thick solution.

- Then the solution is filtered and we obtain green bluish precipitate.
- The precipitate is dried in oven at 100°C for three hours and then calcinated at 200°C for 2 hours. Thus Cu doped MgO Nanoparticles are obtained.



Fig. 1. Cu doped MgO Nanoparticles

- The prepared sample particles were in the range between 20.27 nm to 30.67 nm which is below 100 nm and it was established from X-diffraction.

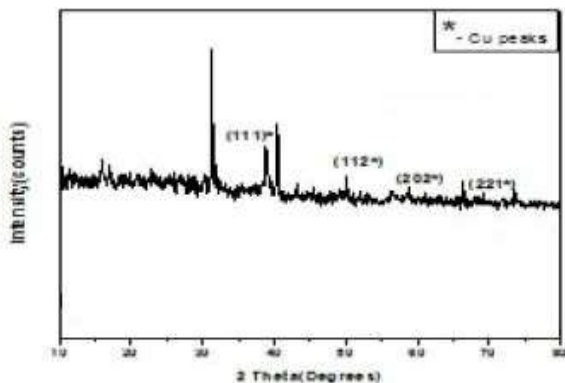


Fig. 2. XRD result of Cu doped MgO Nanoparticles

- SEM analysis of the Cu doped MgO shows that the nanoparticles are agglomerated due to the defects created by Cu doping. With the increase in the dopant concentration, the agglomeration of particles takes place. Thereby the size of the nanoparticles will be increased when compared with pure MgO nanoparticles.

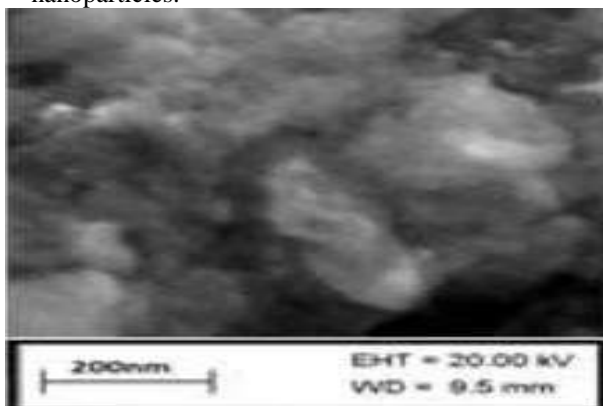


Fig. 3. SEM Image of Cu doped MgO Nanoparticles

### B. Preparation of Cu doped MgO Nanolubricant

Cu doped MgO nanoparticles are added to the compressor lubricant oil in the refrigeration system. The preparation and stability of this lubricant and nanoparticle mixture is more important to the given study. The lubricant oil, commonly used in the refrigeration systems was POE oil. This oil is selected owing to its common usage and superior quality.

Ultrasonic vibration method is used to stabilize the dispersion of the nanoparticles in the lubricant. The steps are involved in the preparation of nano-lubricant is as follows:

- Cu doped MgO nanoparticles are weighed using digital electronic balance with the measurement ranging from 12 mg to 200 mg.
- Add Cu doped MgO nanoparticles into the POE oil and get the Cu doped MgO/POE oil.
- By using an ultrasonic vibrating system, the mixture is vibrated for few hours and as a result Cu doped MgO nanoparticles will get dispersed well into the lubricant oil. The surfactant is not added to this mixture because it may decrease the thermal conductivity and the performance of the system.
- The oil container is kept in the magnetic stirrer to get the homogenization of nano-lubricant. Nano-particles (Cu doped MgO) with 0.2, 0.3 and 0.4 vol. % is added to the POE oil and tested in the setup are prescribed.

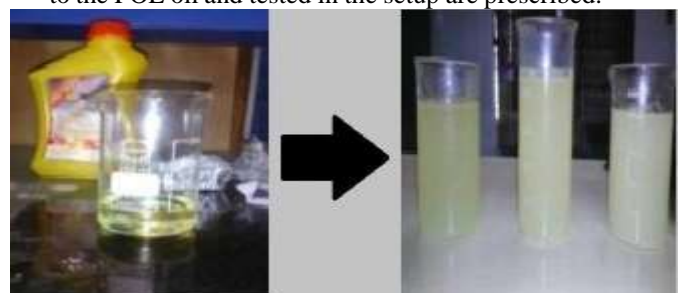


Fig. 4. Pure POE oil with Cu doped MgO Nanoparticles [0.2%, 0.4%, 0.6% vol.]

### III. EXPERIMENTAL WORK

The study was conducted on air conditioning test rig. The test rig consists of a compressor, air-cooled condenser, capillary tube and an evaporator.

The compressor was hermetically sealed reciprocating compressor and the evaporator made of copper. The heat flux was supplied to evaporator by means of heater (230 W) and automatic stirrer to continuously stir the water. The condenser was cooled using fan.

The pressure gauges were installed at the salient point of the refrigeration system. Thermocouples were used to measure temperature at various location of the flow of refrigerant. The power consumption by the compressor was measured using energy meter. The heater power regulator is provided to adjust constant heat flux and maintained steady state condition.

The test rig was filled with N<sub>2</sub> gas at a pressure of 200 psi and this pressure was maintained for 5 hrs. The system was checked for the leakages thoroughly using traditional soap bubble method and ensured for no leakages. The system was evacuated by removing N<sub>2</sub> gas. A vacuum pump was connected to the port provided in the compressor and the

system was completely evacuated for the removal of any impurities. This process was carried out for all the trials. The compressor was filled with the POE oil and the refrigerant R290 was charged through the charging line to the compressor. Every time the system was allowed to stabilize for 15 minutes.



Fig. 5. Air Conditioner Test Rig

The tests are conducted on the air conditioner test rig in the following cases by maintained the evaporator exit temperature  $T_1$  constant at 20°C, 25°C, and 30°C:

Case I: Air conditioning system using R290 as refrigerant and POE oil as compressor lubricant.

Case II: Air conditioning system using R290 as refrigerant and POE oil with Cu doped MgO nanoparticle (0.2% Vol.) as lubricant.

Case III: Air conditioning system using R290 as refrigerant and POE oil with Cu doped MgO nanoparticle (0.4% Vol.) as lubricant.

Case IV: Air conditioning system using R290 as refrigerant and POE oil with Cu doped MgO nanoparticle (0.6% Vol.) as lubricant.

#### IV. RESULTS AND DISCUSSION

##### A. Comparison of Net Refrigeration Effect

When the air conditioning system is operated at constant evaporator exit temperature ( $T_1$ ) of about 20°C, with the increase in concentration of the nanoparticles in the lubricant oil, the Net Refrigeration Effect of the system increased from 345.154 kJ/kg to 350.3 kJ/kg. Similarly when the  $T_1$  is maintained at 25°C and 30°C, the Net Refrigeration Effect of the system increased from 349.532 kJ/kg to 361.999 kJ/kg and from 352.437 kJ/kg to 371.05 kJ/kg respectively. Hence the percentage increase in the Net Refrigeration Effect of the system when  $T_1$  is maintained at 20°C, 25°C, and 30°C is 1.49%, 3.57% and 5.28% respectively.

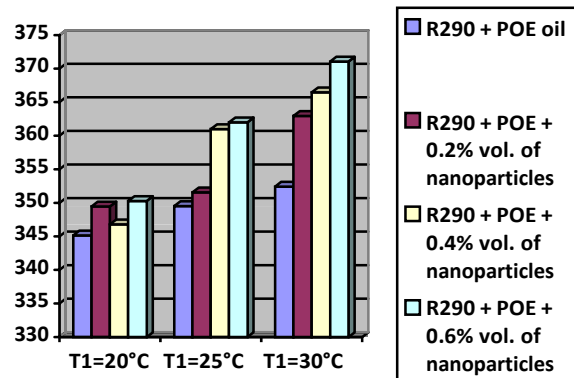


Fig. 6. Comparison of Net Refrigeration Effect

##### B. Comparison of Compressor Work Input

When the air conditioning system is operated at constant evaporator exit temperature ( $T_1$ ) of about 20°C, with the increase in concentration of the nanoparticles in the lubricant oil, the power input to the system decreased from 81.711 kJ/kg to 77.956 kJ/kg.

Similarly when the  $T_1$  is maintained at 25°C and 30°C, the power input to the system decreased from 80.452 kJ/kg to 79.057 kJ/kg and from 80.374 kJ/kg to 78.591 kJ/kg respectively. Hence the percentage decrease in the power input to the system when  $T_1$  is maintained at 20°C, 25°C, and 30°C is 4.6%, 1.73% and 2.22% respectively.

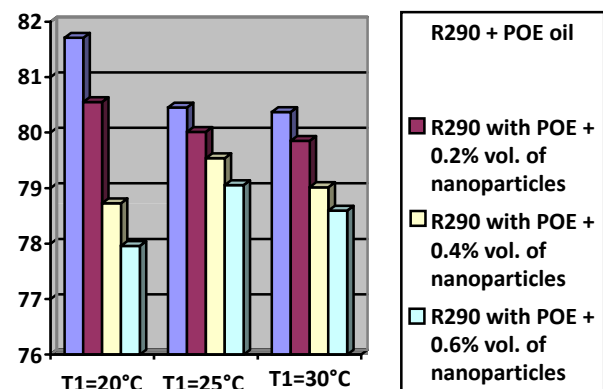


Fig. 7. Comparison of Compressor Work Input

##### C. Comparison of Compression Pressure Ratio

The compression ratio of the system increases with the increase in the volume concentration of the Cu doped MgO nanoparticles in the POE lubricant oil. As the evaporator temperature increases from 20°C to 30°C and the nanoparticles concentration increases from 0% to 0.6% in lubricant oil, the compression ratio increased from 3.671 to 5.417.

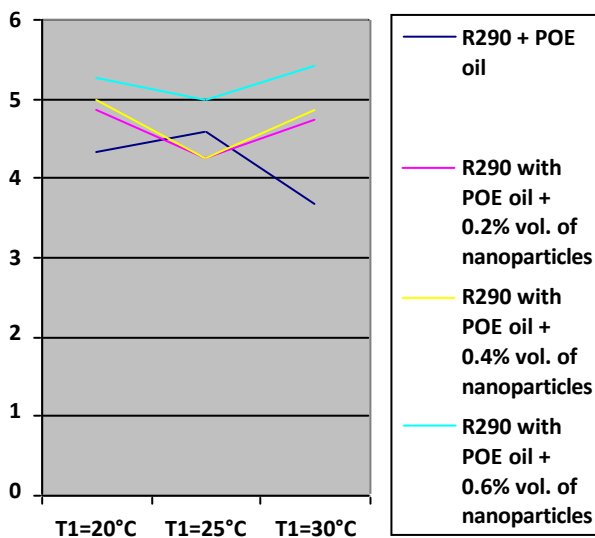


Fig. 8. Comparison of Compressor Pressure Ratio

#### D. Comparison of Coefficient of Performance (COP)

When the air conditioning system is operated at constant evaporator exit temperature ( $T_1$ ) of about 20°C, with the increase in concentration of the nanoparticles in the lubricant oil, the COP of the system increased from 4.22 to 4.499.

Similarly when the  $T_1$  is maintained at 25°C and 30°C, the COP of the system increased from 4.345 to 4.759 and from 4.545 to 4.721 respectively. Hence the percentage increase in the power input to the system when  $T_1$  is maintained at 20°C, 25°C, and 30°C is 6.611%, 5.385% and 7.669% respectively.

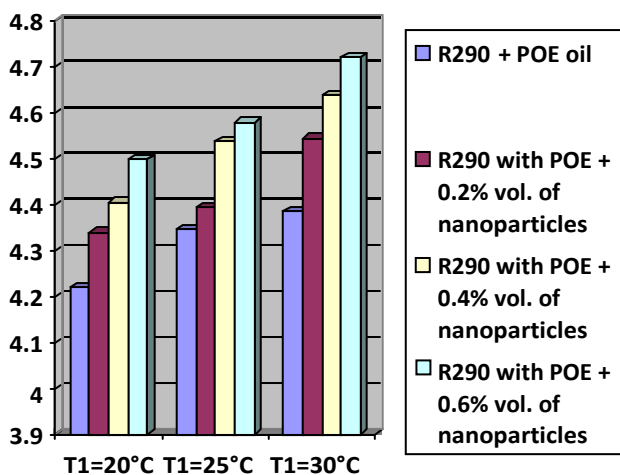


Fig. 9. Comparison of COP

#### V. CONCLUSION

The study results statement and its contributions are concluded in following points:

- A hybrid nanoparticle Cu doped MgO is synthesized and it is used to prepare the nano-lubricant that reduces the compressor work.
- Nanolubricant is prepared by mixing the Cu doped MgO nanoparticles at 0.2% vol., 0.4% vol., and 0.6% vol. concentrations with the polyester oil.
- The performance of the refrigeration system is evaluated by maintaining the evaporator temperature at 20°C, 25°C and 30°C.
- COP is increased when R290 along with nanolubricant is used in the VCRS as compared to that of only R290 refrigerant.
- It is observed that the compressor work input decreased from 81.711 kJ/kg to 78.591 kJ/kg as the concentration of the lubricant oil increased from 0% vol. to 0.6% vol.
- The increase in COP of system when 0.2% vol. and 0.6% vol. of nanoparticles is used more when compared to the increase in COP of system when 0.4% vol. of nanoparticles.
- The maximum increase in the COP of the system is 7.669% and it is observed when 0.6% vol. of the Cu doped MgO nanoparticles with POE oil at 30°C of evaporator temperature. The least increase in COP of system is 1.128 and it is observed when 0.4% vol. of the Cu doped MgO nanoparticles at 25°C of evaporator temperature.

#### REFERENCES

- [1] Sattar MA, Saidur R, Masjuki HH, "Performance investigation of domestic Refrigerator using pure hydrocarbons and blends of hydrocarbons as refrigerants," World Acad. Sci., Eng. Technol, 29, 2007, 223-228.
- [2] Park, Ki Jung, Jung, Dongsoo, "Boiling heat transfer enhancement with carbon nanotubes for refrigerants used in building air-conditioning," Energy and Buildings, 39, 2007, 1061-1064.
- [3] Lee, Kwangho, Hwang, Yujin, Cheong, Seongir, Kwon, Laeun, Kim, Sungchoon, Lee, Jaekun, "Performance evaluation of nano-lubricants of fullerene nanoparticles in refrigeration mineral oil," Current Applied Physics, vol. 9, 2009, 128-131.
- [4] Bi, Sheng shan, Shi, Lin, Zhang, Li, "Application of nanoparticles in domestic refrigerators," Appl. Thermal Eng., 28, 2008, 1834-1843.
- [5] D. Senthilkumar, "Influence of Silicon Carbide Nanopowder in R134a Refrigerant Used in Vapor Compression Refrigeration System," vol. 25, no. 1, pp. 1-10, 2017.
- [6] R. Kumar and J. Singh, "Effect of ZnO nanoparticles in R290 / R600a ( 50 / 50 ) based vapour compression refrigeration system added via lubricant oil on compressor suction and discharge characteristics," Heat Mass Transf., vol. 53, no. 5, pp. 1579-1587, 2017.
- [7] K. Mani and V. Selladurai, "Experimental analysis of a new refrigerant mixture as dropin replacement for CFC12 and HFC134a," Int. J. Therm. Sci., vol. 47, no. 11, pp. 1490-1495, 2008.
- [8] M. E. Haque, R. A. Bakar, K. Kadrigama, M. M. Noor, and M. Shakaib, "Performance of a domestic refrigerator using nanoparticles-based polyolester oil lubricant," J. Mech. Eng. Sci., vol. 10, no. 1, pp. 1778-1791, 2016.